



May 16, 2024

Associate Director, Water Enforcement  
U.S. Environmental Protection Agency  
Region VI  
1201 Elm Street, Suite 500  
Mail Code ECADW  
Dallas, Texas 75270-2102

Via USPS Certified Mail  
# 7021 1970 0000 7631 8459  
Via E-mail: [Smalley.bryant@epa.gov](mailto:Smalley.bryant@epa.gov)

Re: City of Houston Wastewater Consent Decree  
Civil Action No. 4:18-cv-03368  
Monthly SSO Report – April 2024

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for April 2024 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

*I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.*

Sincerely,

DocuSigned by:

A handwritten signature in black ink, appearing to read "Phillip Goodwin", enclosed in a blue DocuSign signature box.

09B3519C2697428...  
Phillip Goodwin

Regulatory Compliance Director  
Houston Public Works, City of Houston

Enc. April 2024 Monthly SSO Report; SSO Map for April 2024  
cc via email: Thomas Carroll, DOJ ([Thomas.Carroll@usdoj.gov](mailto:Thomas.Carroll@usdoj.gov))

James Zimny, EPA ([Zimny.james@epa.gov](mailto:Zimny.james@epa.gov))  
Alan Vaughn, EPA ([vaughn.alan@epa.gov](mailto:vaughn.alan@epa.gov))  
Phillip Ledbetter, Texas AG's Office ([phillip.ledbetter@oag.texas.gov](mailto:phillip.ledbetter@oag.texas.gov));  
James Sallans, TCEQ ([james.sallans@tceq.texas.gov](mailto:james.sallans@tceq.texas.gov))  
Kristen Schlemmer, BCWK ([kristen@bayoucitywaterkeeper.org](mailto:kristen@bayoucitywaterkeeper.org))

PO Box 1562 | Houston, Texas 77251-1562 | [HoustonPublicWorks.org](http://HoustonPublicWorks.org)

**City of Houston - Houston Public Works  
Monthly SSO Report  
April 2024**

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58587	WQ0010495003	2502 SHERIDAN ST	Storm Sewer (not contained)	Yes	648	Manhole	Grease Blockage	4/1/2024	10:01	4/1/2024	15:25	2	Cleared Main Line; Cleaned and Disinfected
58590	WQ0010495126	8320 FM 1960 RD	Storm Sewer (not contained)	Yes	3018	Manhole	Grease Blockage	4/1/2024	10:51	4/2/2024	12:00	2	Cleared Main Line; Cleaned and Disinfected
58593	WQ0010495037	10330 BASSOON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/1/2024	11:34	4/1/2024	11:35	0	Cleaned and Disinfected; Cleared Service Lateral
58599	WQ0010495090	5609 CRANE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/1/2024	14:02	4/1/2024	14:03	0	Cleaned and Disinfected; Cleared City Clean Out
58600	WQ0010495002	4318 SUNFLOWER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/1/2024	15:04	4/1/2024	15:05	0	Cleaned and Disinfected; Cleared City Clean Out
58601	WQ0010495109	1714 WOODLAND PARK DR	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	4/1/2024	15:26	4/1/2024	15:27	0	Cleared City Clean Out; Cleaned and Disinfected
58602	WQ0010495119	8620 BISSONNET ST	Storm Sewer (not contained)	Yes	2500	Force Main	Collection system structural failure	4/1/2024	14:42	4/2/2024	12:30	2	Cleaned and Disinfected; Contain All or Portion of Spill
58607	WQ0010495002	8018 HICKOK LN	Storm Sewer - contained on site	No	0	City Cleanout	Collection system structural failure	4/1/2024	16:35	4/1/2024	16:36	0	Cleared City Clean Out; Cleaned and Disinfected
58608	WQ0010495002	8511 WIER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	4/2/2024	9:40	4/2/2024	9:41	0	Cleaned and Disinfected; Cleared Main Line
58609	WQ0010495090	800 LOCKWOOD DR	Storm Sewer (not contained)	Yes	1431	Manhole	Rags/Wipes	4/2/2024	10:54	4/2/2024	18:51	3	Cleaned and Disinfected; Cleared Main Line
58610	WQ0010495023	8151 MILEY ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	4/2/2024	11:23	4/2/2024	11:24	0	Cleaned and Disinfected; Cleared City Clean Out
58612	WQ0010495030	2930 SAM HOUSTON PKWY	Storm Sewer (not contained)	Yes	567	City Cleanout	Rags/Wipes	4/2/2024	11:31	4/2/2024	14:40	3	Cleaned and Disinfected; Cleared City Clean Out
58613	WQ0010495090	5603 DENMARK ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Grease Blockage	4/2/2024	11:50	4/2/2024	11:51	0	Cleaned and Disinfected; Cleared Main Line
58616	WQ0010495016	11032 SPOTTSWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/2/2024	16:18	4/2/2024	16:19	0	Cleaned and Disinfected
58631	WQ0010495037	8401 WESTGLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	806	City Cleanout	Grease Blockage	4/2/2024	8:47	4/2/2024	15:30	2	Cleaned and Disinfected; Cleared Main Line
58633	WQ0010495146	3928 KINGWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	150	Lift Station	Collection system temporary blockage	4/2/2024	15:32	4/2/2024	17:32	1	Cleaned and Disinfected
58620	WQ0010495002	2301 WILSHIRE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	515	Private Cleanout	Grease Blockage	4/3/2024	9:31	4/3/2024	18:06	1	Cleaned and Disinfected; Cleared Main Line
58621	WQ0010495099	9904 DEANWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/3/2024	10:02	4/3/2024	10:03	0	Cleaned and Disinfected; Cleared Service Lateral
58623	WQ0010495110	15778 CLARKE SPRINGS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	4660	Manhole	Grease Blockage	4/3/2024	9:58	4/5/2024	0:48	2	Cleared Main Line; Cleaned and Disinfected
58625	WQ0010495090	4417 OATS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/3/2024	11:13	4/3/2024	11:14	0	Cleaned and Disinfected
58626	WQ0010495002	7415 STANWICK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	4/3/2024	11:07	4/3/2024	11:08	0	Cleaned and Disinfected; Cleared City Clean Out

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58627	WQ0010495037	6700 BELLAIRE BLVD	Storm Sewer (not contained)	Yes	325	Manhole	Rags/Wipes	4/3/2024	10:55	4/3/2024	16:20	1	Cleaned and Disinfected; Cleared Main Line
58630	WQ0010495150	12323 BLUE RIVER DR	Bayou/surface water/drainage ditch	Yes	566	Manhole	Collection system structural blockage	4/3/2024	12:12	4/3/2024	16:55	2	Cleaned and Disinfected
58634	WQ0010495077	12806 COULSON ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Grease Blockage	4/3/2024	16:28	4/3/2024	16:29	0	Cleaned and Disinfected; Cleared Main Line
58638	WQ0010495090	5703 CHRYSTELL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/4/2024	10:40	4/4/2024	10:41	0	Cleared Service Lateral; Cleaned and Disinfected
58640	WQ0010495116	13319 ASCOT GLEN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/4/2024	11:13	4/4/2024	11:14	0	Cleared Service Lateral; Cleaned and Disinfected
58644	WQ0010495090	333 LOOP FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/4/2024	15:40	4/4/2024	15:41	0	Cleaned and Disinfected
58647	WQ0010495003	4126 BRISBANE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	4/4/2024	14:10	4/4/2024	14:11	0	Cleaned and Disinfected
58648	WQ0010495077	12914 MYRTLE LN	Storm Sewer - contained on site	No	0	Service Lateral	Collection system structural blockage	4/4/2024	15:47	4/4/2024	15:48	0	Cleaned and Disinfected; Cleared Service Lateral
58650	WQ0010495090	1002 GARDNER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/4/2024	16:00	4/4/2024	16:01	0	Cleaned and Disinfected
58651	WQ0010495119	8526 BEECHNUT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/4/2024	16:25	4/4/2024	16:26	0	Cleaned and Disinfected; Cleared Service Lateral
58653	WQ0010495090	1442 FREEDONIA DR	Storm Sewer (not contained)	Yes	343	Manhole	Grease Blockage	4/5/2024	8:58	4/5/2024	14:41	1	Cleaned and Disinfected; Cleared Main Line
58655	WQ0010495090	5512 BUNTE ST	Storm Sewer - contained on site	No	0	City Cleanout	Grease Blockage	4/5/2024	13:23	4/5/2024	13:24	0	Cleaned and Disinfected; Cleared City Clean Out
58657	WQ0010495150	12202 RIVER TRAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	302	Manhole	Collection system structural blockage	4/5/2024	13:25	4/5/2024	15:56	2	Set Bypass Pump; Cleaned and Disinfected
58658	WQ0010495003	6319 HEATHERBROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/5/2024	14:21	4/5/2024	14:22	0	Cleaned and Disinfected
58660	WQ0010495016	5923 GUADALUPE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural blockage	4/5/2024	16:25	4/5/2024	16:26	0	Cleaned and Disinfected
58661	WQ0010495075	11430 SAGEHURST LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural failure	4/5/2024	15:40	4/5/2024	15:41	0	Set Bypass Pump; Contain All or Portion of Spill
58662	WQ0010495076	5642 LONG CREEK LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/6/2024	8:01	4/6/2024	8:02	0	Cleaned and Disinfected; Cleared Main Line
58664	WQ0010495002	6410 LAZARAS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	4/6/2024	8:42	4/6/2024	8:43	0	Cleared City Clean Out; Cleaned and Disinfected
58665	WQ0010495090	3838 SEARLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural failure	4/6/2024	9:04	4/6/2024	9:05	0	Cleaned and Disinfected; Set Bypass Pump

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58668	WQ0010495090	7102 HILLSBORO ST	Storm Sewer - contained on site	No	0	Service Lateral	Collection system structural failure	4/7/2024	10:28	4/7/2024	10:29	0	Cleaned and Disinfected
58675	WQ0010495090	410 ROBERTS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	4/8/2024	9:21	4/8/2024	9:22	0	Cleaned and Disinfected
58678	WQ0010495077	1624 DUNA WAY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/8/2024	11:28	4/8/2024	11:29	0	Cleaned and Disinfected
58680	WQ0010495037	7923 QUAIL MEADOW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/8/2024	11:44	4/8/2024	11:45	0	Set Bypass Pump; Cleaned and Disinfected
58686	WQ0010495002	1735 PASADENA ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Collection system temporary blockage	4/8/2024	13:35	4/8/2024	13:36	0	Cleaned and Disinfected
58690	WQ0010495090	6508 CORPUS CHRISTI ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	4/8/2024	14:38	4/8/2024	14:39	0	Cleaned and Disinfected
58695	WQ0010495010	210 BOLDEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	4/8/2024	16:24	4/8/2024	16:25	0	Cleared City Clean Out; Cleaned and Disinfected
58697	WQ0010495009	4745 CARMEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/9/2024	8:56	4/9/2024	8:57	0	Cleaned and Disinfected; Set Bypass Pump
58702	WQ0010495090	6419 COCHRAN ST	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural failure	4/9/2024	11:30	4/9/2024	11:31	0	Cleaned and Disinfected
58703	WQ0010495148	10103 TIDWELL RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/9/2024	12:43	4/9/2024	12:44	0	Cleaned and Disinfected
58704	WQ0010495090	601 7TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/9/2024	13:05	4/9/2024	13:06	0	Cleaned and Disinfected
58705	WQ0010495010	9737 PLUMMER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/9/2024	13:47	4/9/2024	13:48	0	Cleaned and Disinfected; Cleared City Clean Out
58710	WQ0010495090	2419 PANNELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	50	City Cleanout	Rags/Wipes	4/9/2024	12:25	4/9/2024	13:15	1	Cleared City Clean Out; Cleaned and Disinfected; Cleared City Clean Out
58712	WQ0010495075	11598 HUGHES RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Force Main	Collection system structural failure	4/9/2024	12:45	4/9/2024	12:46	0	Contain All or Portion of Spill; Set Bypass Pump
58714	WQ0010495037	10715 WILLOWGROVE DR	Storm Sewer (not contained)	Yes	2300	Manhole	Rags/Wipes	4/10/2024	8:30	4/10/2024	16:10	5	Cleared Main Line; Cleaned and Disinfected
58715	WQ0010495090	8007 CAPITOL ST	Storm Sewer (not contained)	Yes	122	Manhole	Collection system - wet weather	4/10/2024	9:14	4/10/2024	10:15	2	Cleaned and Disinfected
58721	WQ0010495090	2105 MARONEAL ST	Storm Sewer (not contained)	Yes	0	Manhole	Collection system structural blockage	4/10/2024	10:08	4/12/2024	6:24	0	Cleaned and Disinfected; Set Bypass Pump
58722	WQ0010495002	3802 TUAM ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	4/10/2024	12:47	4/10/2024	12:48	0	Cleared City Clean Out; Cleaned and Disinfected

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58723	WQ0010495112	27514 HUFFMAN CLEVELAND RD	Storm Sewer (not contained)	Yes	0	Manhole	Pump/Lift Station Electrical Failure	4/10/2024	11:56	4/10/2024	16:22	0	Cleaned and Disinfected
58724	WQ0010495010	114 DE HAVEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/10/2024	11:46	4/10/2024	11:47	0	Cleared Main Line; Cleaned and Disinfected
58725	WQ0010495150	12202 RIVER TRAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1250	Manhole	Collection system structural failure	4/10/2024	13:40	4/10/2024	15:45	10	Set Bypass Pump; Cleaned and Disinfected
58726	WQ0010495090	1302 21ST ST	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural failure	4/10/2024	16:05	4/10/2024	16:06	0	Cleaned and Disinfected; Cleared Service Lateral
58729	WQ0010495150	12202 RIVER TRAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system structural blockage	4/11/2024	9:51	4/11/2024	9:52	0	Cleaned and Disinfected; Set Bypass Pump
58734	WQ0010495002	1557 GODWIN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	4/11/2024	16:03	4/11/2024	16:04	0	Cleaned and Disinfected; Cleared Main Line
58735	WQ0010495090	705 STANFORD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/12/2024	10:00	4/12/2024	14:32	0	Cleaned and Disinfected; Set Bypass Pump
58737	WQ0010495090	6842 AVENUE T	Storm Sewer (not contained)	Yes	0	Service Lateral	Collection system structural failure	4/12/2024	11:01	4/12/2024	11:02	0	Cleaned and Disinfected; Set Bypass Pump
58738	WQ0010495150	12202 RIVER TRAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	189	Manhole	Collection system structural failure	4/12/2024	11:43	4/12/2024	12:45	3	Cleared Main Line; Cleaned and Disinfected; Set Bypass Pump
58739	WQ0010495003	4294 CHILDRESS ST	Storm Sewer (not contained)	Yes	1195	Manhole	Grease Blockage	4/12/2024	11:45	4/12/2024	15:44	5	Cleaned and Disinfected; Cleared Main Line
58741	WQ0010495076	5731 KNOBBY KNOLL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/12/2024	14:29	4/12/2024	14:30	0	Cleared Main Line; Cleaned and Disinfected
58742	WQ0010495002	5700 H MARK CROSSWELL JR ST	Storm Sewer (not contained)	Yes	714	Manhole	Grease Blockage	4/12/2024	15:22	4/12/2024	17:21	6	Cleaned and Disinfected; Cleared Main Line
58743	WQ0010495002	5230 WINDEMERE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/12/2024	16:15	4/12/2024	16:16	0	Cleaned and Disinfected; Cleared Service Lateral
58744	WQ0010495003	14025 WRIGLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/12/2024	16:14	4/12/2024	16:15	0	Cleaned and Disinfected; Cleared City Clean Out
58745	WQ0010495090	2603 NAVIGATION BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/12/2024	17:35	4/12/2024	17:36	0	Cleaned and Disinfected; Cleared City Clean Out
58747	WQ0010495090	4104 ENGELKE ST	Storm Sewer - contained on site	No	0	City Cleanout	Collection system structural failure	4/12/2024	18:00	4/12/2024	18:01	0	Cleaned and Disinfected
58748	WQ0010495002	7213 KASSARINE PASS	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/13/2024	9:25	4/13/2024	9:26	0	Cleared Main Line; Cleaned and Disinfected
58751	WQ0010495075	11914 BINGHAMPTON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/13/2024	12:11	4/13/2024	12:12	0	Cleaned and Disinfected

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58752	WQ0010495003	11806 SORSBY WAY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	240	Manhole	Grease Blockage	4/13/2024	12:52	4/13/2024	14:52	2	Cleared Main Line; Cleaned and Disinfected
58754	WQ0010495090	8414 BERTWOOD ST	Storm Sewer - contained on site	No	0	City Cleanout	Grease Blockage	4/13/2024	15:32	4/13/2024	15:33	0	Cleaned and Disinfected; Cleared City Clean Out
58762	WQ0010495110	17339 EDGEHAVEN DR	Storm Sewer (not contained)	Yes	622	Manhole	Grease Blockage	4/14/2024	13:36	4/15/2024	10:20	0	Cleaned and Disinfected; Cleared Main Line
58763	WQ0010495090	1505 CAVALCADE ST	Storm Sewer (not contained)	Yes	393	Manhole	Grease Blockage	4/15/2024	8:42	4/16/2024	10:53	0	Cleared Main Line; Cleaned and Disinfected
58765	WQ0010495090	5001 LIDO LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/16/2024	14:00	4/16/2024	14:01	0	Cleaned and Disinfected; Cleared Service Lateral
58767	WQ0010495002	4318 SUNFLOWER ST	Storm Sewer - contained on site	No	0	City Cleanout	Collection system temporary blockage	4/15/2024	13:26	4/15/2024	13:27	0	Cleaned and Disinfected
58770	WQ0010495090	2702 AMBOY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/15/2024	14:05	4/15/2024	14:06	0	Cleaned and Disinfected
58773	WQ0010495003	3126 DULCREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/15/2024	16:32	4/15/2024	16:33	0	Cleared City Clean Out; Cleaned and Disinfected
58774	WQ0010495090	4101 OATS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/15/2024	16:41	4/15/2024	16:42	0	Cleaned and Disinfected; Cleared Service Lateral
58775	WQ0010495090	318 FRISCO ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/16/2024	8:30	4/16/2024	8:31	0	Cleared Main Line; Cleaned and Disinfected
58778	WQ0010495090	5603 DENMARK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Grease Blockage	4/16/2024	9:40	4/16/2024	9:41	0	Cleaned and Disinfected; Cleared Main Line
58779	WQ0010495090	162 MALONE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	174	Manhole	Grease Blockage	4/16/2024	9:32	4/16/2024	12:25	1	Cleared Main Line; Cleaned and Disinfected
58782	WQ0010495002	4341 MACGREGOR WAY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/16/2024	12:23	4/16/2024	12:24	0	Cleaned and Disinfected
58784	WQ0010495030	2017 SHADOWDALE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/16/2024	12:29	4/16/2024	12:30	0	Cleared City Clean Out; Cleaned and Disinfected
58787	WQ0010495002	7132 LAWNSDALE ST	Storm Sewer (not contained)	Yes	502	Service Lateral	Collection system structural failure	4/16/2024	14:25	4/17/2024	16:04	0	Set Bypass Pump; Cleaned and Disinfected
58795	WQ0010495150	6602 WINFIELD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	870	Manhole	Collection system structural failure	4/17/2024	9:25	4/17/2024	16:40	2	Cleaned and Disinfected; Set Bypass Pump
58796	WQ0010495030	10107 WESTVIEW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/17/2024	15:20	4/17/2024	16:05	0	Cleaned and Disinfected; Set Bypass Pump
58797	WQ0010495002	1736 PASADENA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/17/2024	11:03	4/17/2024	11:04	0	Cleaned and Disinfected; Cleared City Clean Out
58798	WQ0010495126	8450 WILLOW PLACE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/17/2024	10:30	4/17/2024	10:31	0	Cleared Main Line; Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58801	WQ0010495090	2901 FULTON ST	Bayou/surface water/drainage ditch	Yes	765	Manhole	Grease Blockage	4/17/2024	11:15	4/17/2024	15:30	3	Cleaned and Disinfected; Cleared Main Line
58803	WQ0010495079	11210 NEWTON ST	Storm Sewer (not contained)	Yes	1217	Manhole	Grease Blockage	4/17/2024	13:18	4/18/2024	9:35	1	Cleaned and Disinfected; Set Bypass Pump
58813	WQ0010495016	9002 STERLINGSHIRE ST	Storm Sewer (not contained)	Yes	198	Manhole	Grease Blockage	4/18/2024	15:21	4/18/2024	18:39	1	Cleaned and Disinfected; Cleared Main Line
58814	WQ0010495002	7720 KINGSLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	552	City Cleanout	Grease Blockage	4/18/2024	16:04	4/18/2024	18:57	3	Cleaned and Disinfected; Cleared City Clean Out
58822	WQ0010495009	5247 FAIRGREEN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/19/2024	17:00	4/19/2024	17:01	0	Cleaned and Disinfected; Cleared Service Lateral
58823	WQ0010495090	2915 TRENTON RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/20/2024	8:33	4/20/2024	8:34	0	Cleared Service Lateral; Cleaned and Disinfected
58825	WQ0010495002	3448 COYLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/20/2024	11:39	4/20/2024	11:40	0	Cleared Main Line; Cleaned and Disinfected
58826	WQ0010495002	5014 RAPIDO RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/20/2024	16:11	4/20/2024	16:12	0	Cleared Main Line; Cleaned and Disinfected
58831	WQ0010495077	11623 LAFFERTY OAKS ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	918	Manhole	Collection system structural blockage	4/21/2024	9:43	4/21/2024	17:22	2	Cleared Main Line; Cleaned and Disinfected
58832	WQ0010495002	6658 CRESTRIDGE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	4/21/2024	12:03	4/21/2024	12:04	0	Cleared Main Line; Cleaned and Disinfected
58837	WQ0010495030	10431 METRONOME DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/22/2024	8:15	4/22/2024	8:16	0	
58840	WQ0010495090	6842 AVENUE T	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/22/2024	11:55	4/22/2024	11:56	0	Set Bypass Pump
58842	WQ0010495075	11914 BINGHAMPTON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/22/2024	14:45	4/22/2024	14:46	0	Cleaned and Disinfected
58844	WQ0010495090	929 25TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/23/2024	10:56	4/23/2024	10:57	0	Cleaned and Disinfected
58845	WQ0010495090	9120 KENILWORTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural failure	4/23/2024	8:00	4/23/2024	8:01	0	Cleaned and Disinfected
58846	WQ0010495002	2815 NAPOLEON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/23/2024	9:21	4/23/2024	9:22	0	Cleaned and Disinfected
58848	WQ0010495003	2220 DEVONSHIRE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/23/2024	10:15	4/23/2024	10:16	0	Cleared Main Line; Cleaned and Disinfected
58850	WQ0010495090	1635 LOOP FWY	Bayou/surface water/drainage ditch	Yes	70	Manhole	Rags/Wipes	4/23/2024	12:40	4/23/2024	13:50	1	Cleaned and Disinfected; Cleared Main Line
58851	WQ0010495077	1711 WATKIN WAY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	4/23/2024	13:32	4/23/2024	13:33	0	Cleaned and Disinfected; Set Bypass Pump

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58852	WQ0010495109	2150 BENTWORTH DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural blockage	4/23/2024	14:22	4/23/2024	14:23	0	Cleaned and Disinfected; Set Bypass Pump
58855	WQ0010495090	6823 MORROW ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	4/23/2024	16:09	4/23/2024	16:10	0	Cleared City Clean Out; Cleaned and Disinfected
58857	WQ0010495090	1321 STUDEWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	4/24/2024	8:50	4/24/2024	19:23	0	Cleaned and Disinfected
58858	WQ0010495003	3126 DULCREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	4/24/2024	8:50	4/24/2024	8:51	0	Cleared City Clean Out; Cleaned and Disinfected
58859	WQ0010495002	6323 ENGLAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/24/2024	10:49	4/24/2024	10:50	0	Cleaned and Disinfected
58860	WQ0010495003	2240 MIMOSA DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	4/24/2024	11:30	4/24/2024	11:31	0	Set Bypass Pump; Cleaned and Disinfected
58864	WQ0010495003	2501 BRANARD ST	Storm Sewer (not contained)	Yes	1065	Manhole	Grease Blockage	4/24/2024	13:54	4/24/2024	17:27	5	Cleared Main Line; Cleaned and Disinfected
58870	WQ0010495110	16219 PURPLERIDGE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/25/2024	8:58	4/25/2024	8:59	0	Cleared Main Line; Cleaned and Disinfected
58874	WQ0010495002	1320 SCOTT ST	Storm Sewer (not contained)	Yes	807	Manhole	Grease Blockage	4/25/2024	11:34	4/25/2024	16:03	3	Cleaned and Disinfected; Cleared Main Line
58876	WQ0010495030	9941 SHADOW WOOD DR	Storm Sewer (not contained)	Yes	207	Manhole	Grease Blockage	4/25/2024	11:38	4/25/2024	15:04	1	Cleared Main Line; Cleaned and Disinfected
58877	WQ0010495003	4332 GARROTT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/25/2024	12:07	4/26/2024	10:36	0	Cleared City Clean Out; Cleaned and Disinfected
58884	WQ0010495090	10309 PEACH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	10	Service Lateral	Collection system structural failure	4/26/2024	10:05	4/26/2024	10:06	10	Cleaned and Disinfected
58885	WQ0010495090	1009 F 24TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/26/2024	10:00	4/26/2024	12:51	0	Cleared Main Line
58886	WQ0010495090	819 18TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	4/26/2024	10:17	4/26/2024	10:18	0	Cleaned and Disinfected
58888	WQ0010495090	9346 WALTERVILLE RD	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Collection system structural failure	4/26/2024	13:27	4/26/2024	13:28	0	Cleaned and Disinfected
58891	WQ0010495076	6621 GREENHURST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	4/26/2024	15:45	4/26/2024	15:46	0	Cleaned and Disinfected
58896	WQ0010495090	3333 KATY FRY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system structural failure	4/27/2024	10:48	4/27/2024	10:49	0	Cleaned and Disinfected; Cleared Main Line
58906	WQ0010495002	2120 WALKER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/28/2024	12:30	4/28/2024	14:02	0	Cleaned and Disinfected; Cleared Service Lateral; Cleared Main Line
58909	WQ0010495076	5700 THOUSAND OAKS CIR	Storm Sewer (not contained)	Yes	159	Manhole	Grease Blockage	4/29/2024	10:55	4/29/2024	13:34	1	Cleared Main Line; Cleaned and Disinfected


Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
58910	WQ0010495002	6658 CRESTRIDGE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/29/2024	11:45	4/29/2024	11:46	0	Cleaned and Disinfected; Cleared City Clean Out
58911	WQ0010495075	12027 RHINEBECK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/29/2024	11:10	4/29/2024	11:11	0	Cleared City Clean Out; Cleaned and Disinfected
58912	WQ0010495016	7868 GALLAHAD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	4/30/2024	11:37	4/30/2024	11:38	0	Cleaned and Disinfected; Set Bypass Pump
58913	WQ0010495037	706 BUCKINGHAM DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	4/29/2024	14:24	4/29/2024	14:25	0	Cleared City Clean Out; Cleaned and Disinfected
58914	WQ0010495099	6815 INWOOD WEST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1291	City Cleanout	Grease Blockage	4/29/2024	14:47	4/30/2024	12:18	1	Cleaned and Disinfected; Cleared City Clean Out
58915	WQ0010495037	8402 MCAVOY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	4/29/2024	17:08	4/29/2024	17:08	0	Set Bypass Pump
58917	WQ0010495090	168 TURNER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	4/29/2024	16:43	4/29/2024	16:44	0	Cleaned and Disinfected
58918	WQ0010495090	1702 CHESTNUT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	4/29/2024	17:07	4/29/2024	17:08	0	Cleaned and Disinfected; Cleared City Clean Out
58919	WQ0010495030	10107 WESTVIEW DR	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural failure	4/29/2024	17:42	4/29/2024	17:47	0	Set Bypass Pump; Cleaned and Disinfected
58921	WQ0010495119	8315 JORINE DR	Storm Sewer (not contained)	Yes	834	Manhole	Grease Blockage	4/30/2024	9:20	4/30/2024	13:58	3	Cleared Main Line; Cleaned and Disinfected
58923	WQ0010495090	105 ROCKY CREEK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/30/2024	10:24	4/30/2024	10:25	0	Cleared Main Line; Cleaned and Disinfected
58924	WQ0010495090	7913 LONGRIDGE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	4/30/2024	11:34	4/30/2024	11:35	0	Cleared Main Line; Cleaned and Disinfected
58926	WQ0010495037	12003 VALLEY HILLS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	630	Manhole	Grease Blockage	4/30/2024	12:45	5/1/2024	15:57	0	Cleared Main Line; Cleaned and Disinfected
58928	WQ0010495009	3811 FUQUA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	4/30/2024	14:34	4/30/2024	14:35	0	Cleaned and Disinfected; Cleared Service Lateral
58932	WQ0010495002	3409 POLK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	4/30/2024	15:58	4/30/2024	15:59	0	Cleaned and Disinfected

Total Number of SSOs:	148
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

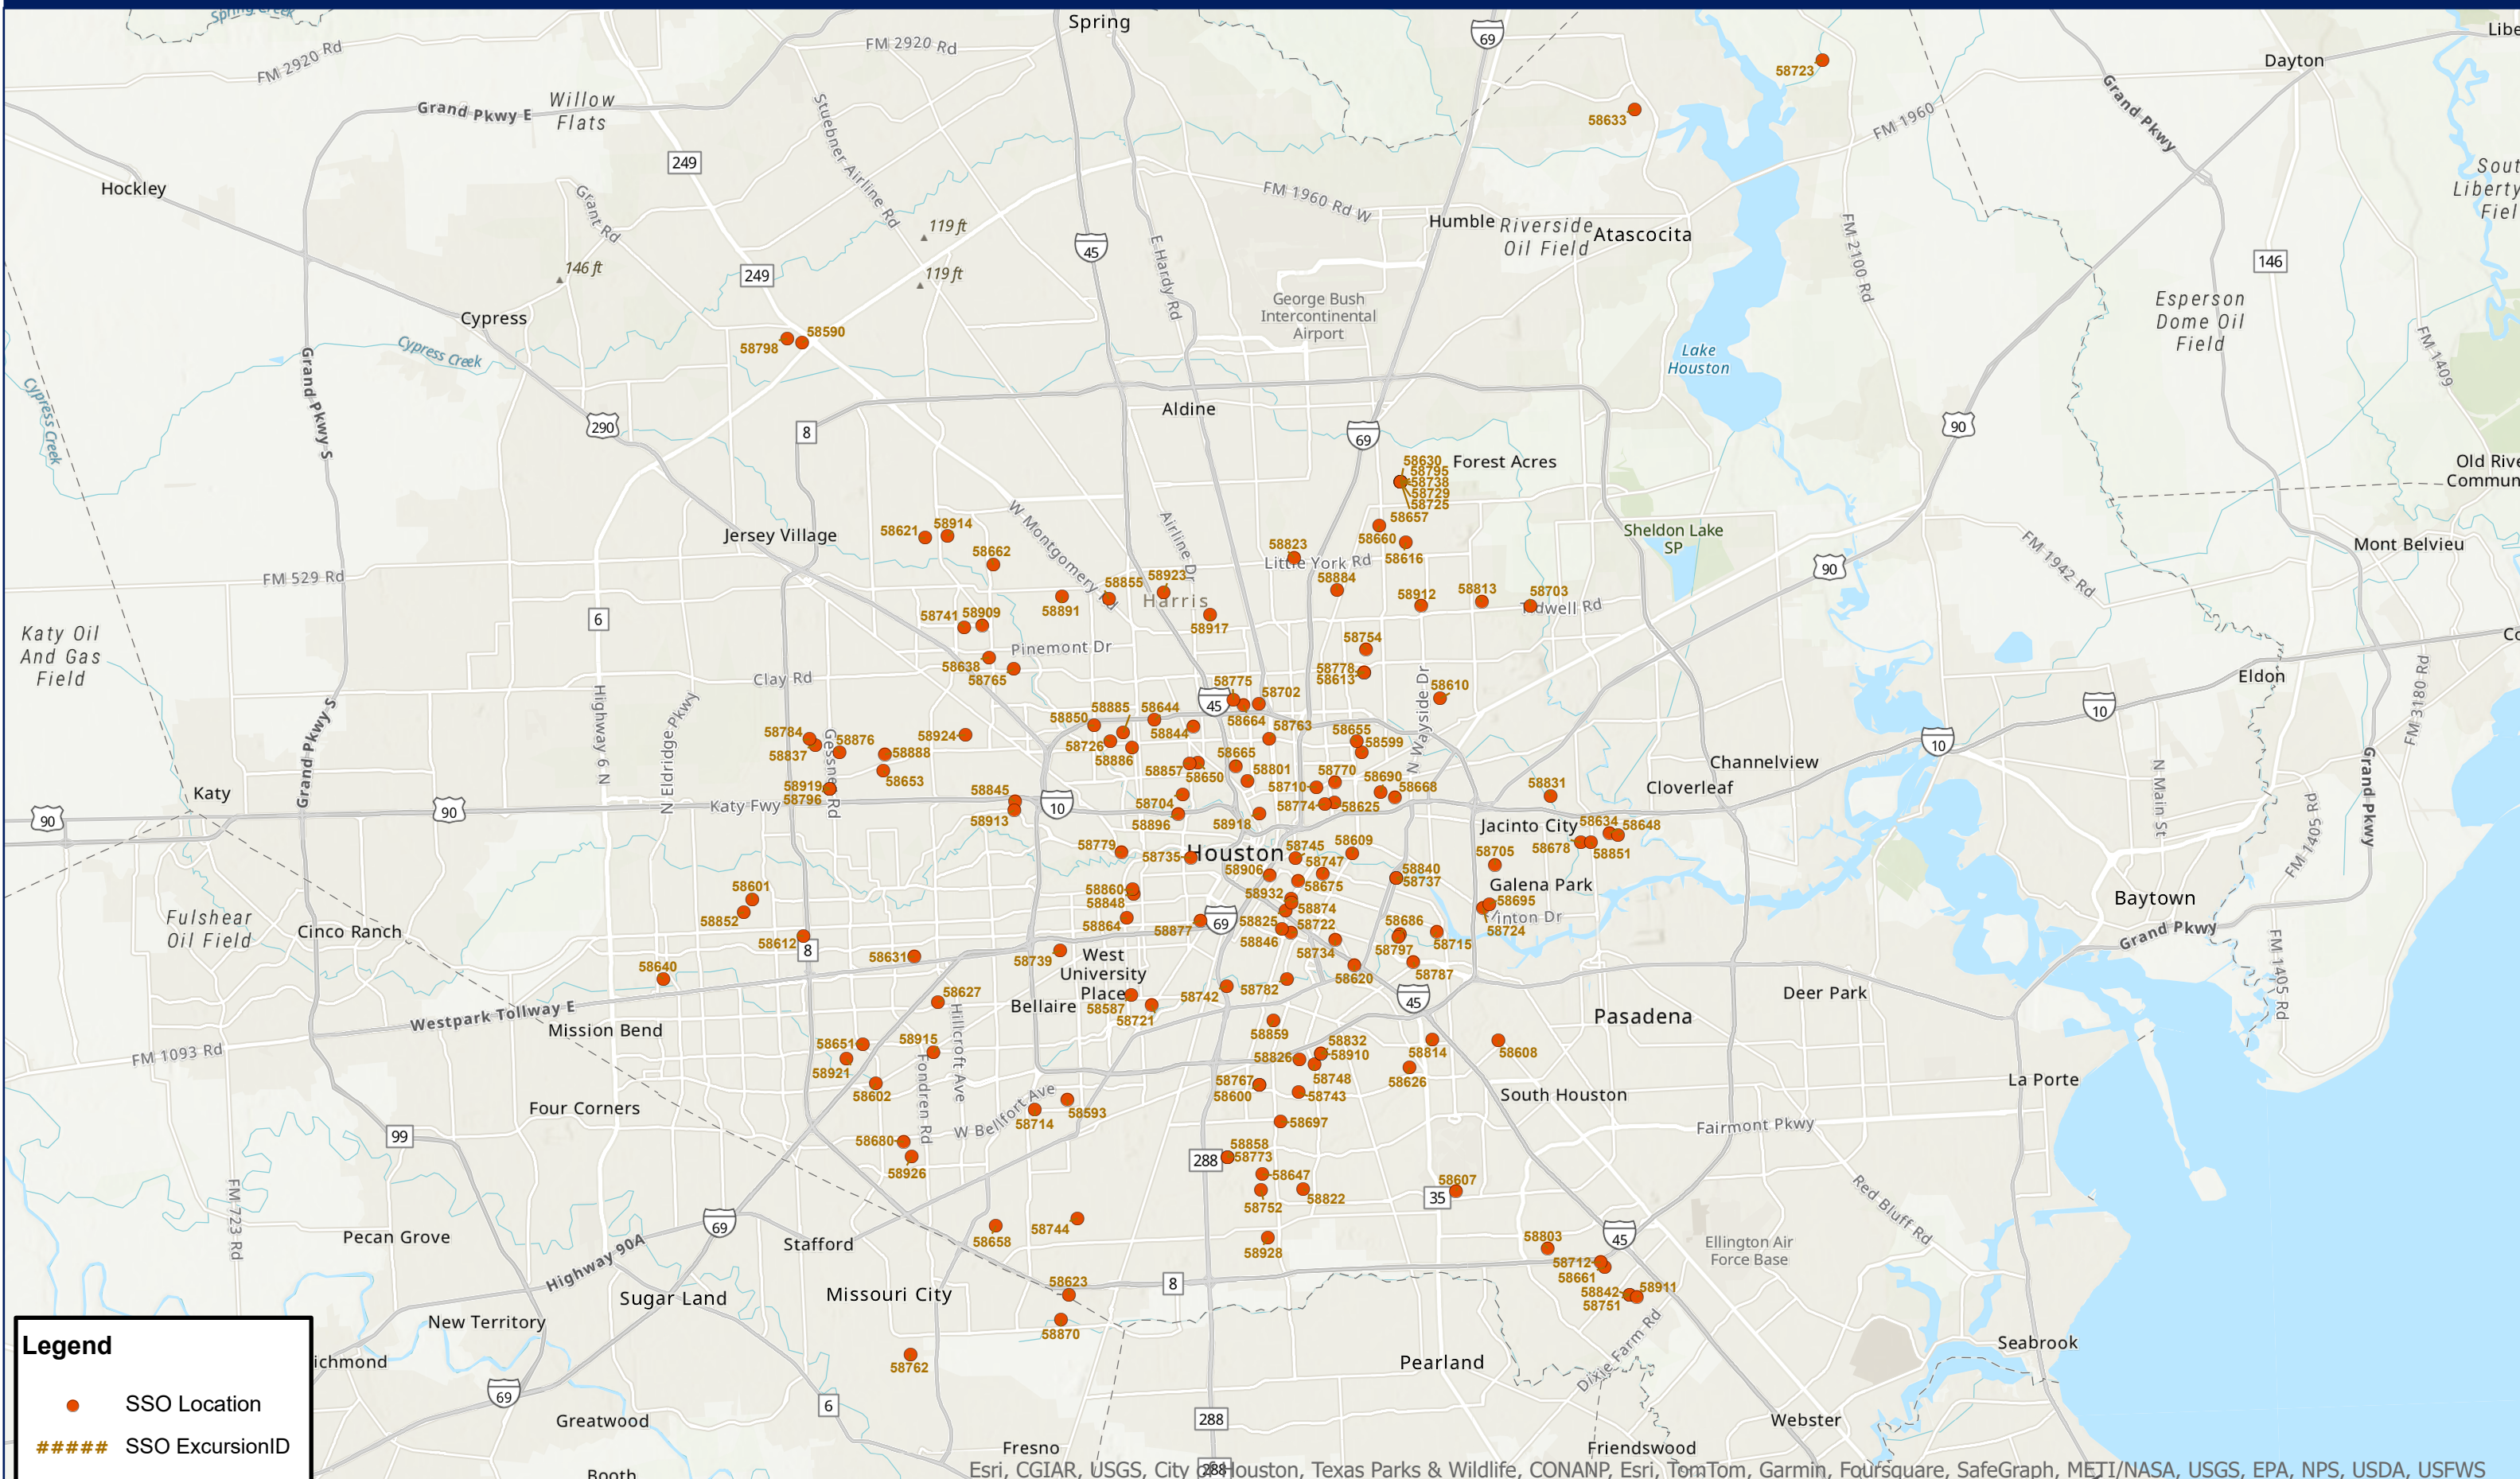

**Legend**

- SSO Location
- ##### SSO ExcursionID

## Public SSO Map - April 2024



Document Path: C:\Users\j1752\OneDrive - City of Houston\Desktop\Projects\SSO\SSO Public SSO Monthly Map.aprx Date: 5/10/2024 Map By: E17523



Geospatial or map data maintained by Houston Public Works is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and only represents the approximate location of property boundaries.