



March 19, 2026

Associate Director, Water Enforcement  
U.S. Environmental Protection Agency  
Region VI  
1201 Elm Street, Suite 500  
Mail Code ECADW  
Dallas, Texas 75270-2102

Via E-mail: [Smalley.bryant@epa.gov](mailto:Smalley.bryant@epa.gov)

Re: City of Houston Wastewater Consent Decree  
Civil Action No. 4:18-cv-03368  
Monthly SSO Report – February 2026

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for February 2026 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

*I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.*

Sincerely,

A digital signature of Phillip Goodwin, showing a stylized signature in blue ink over a white background with a DocuSigned logo.

Phillip Goodwin

Regulatory Compliance Director  
Houston Public Works, City of Houston

Enc. February 2026 Monthly SSO Report; SSO Map for February 2026  
cc via email: Thomas Carroll, DOJ ([Thomas.Carroll@usdoj.gov](mailto:Thomas.Carroll@usdoj.gov))  
James Zimny, EPA ([Zimny.james@epa.gov](mailto:Zimny.james@epa.gov))  
Alan Vaughn, EPA ([vaughn.alan@epa.gov](mailto:vaughn.alan@epa.gov))  
Brittany Wright, Texas AG's Office ([Brittany.Wright@oag.texas.gov](mailto:Brittany.Wright@oag.texas.gov))  
James Sallans, TCEQ ([james.sallans@tceq.texas.gov](mailto:james.sallans@tceq.texas.gov))  
Kristen Schlemmer, BCWK ([kristen@bayoucitywaterkeeper.org](mailto:kristen@bayoucitywaterkeeper.org))



City of Houston - Houston Public Works  
 Monthly SSO Report  
 February 2026

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
66322	WQ0010495135	1706 CHESAPEAKE BAY CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravily Main	Collection system structural blockage	2/3/2026	10:45:00 AM	2/3/2026	10:45:00 AM	0	Cleaned and Disinfected; Cleared Main Line
66331	WQ0010495009	4228 BELLFORT ST	Storm Sewer (not contained)	Yes	121	City Cleanout	Collection system structural blockage	2/1/2026	1:55:00 PM	2/1/2026	3:56:37 PM	1	Cleared Service Lateral; Cleaned and Disinfected
66338	WQ0010495090	818 OLIVE ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Grease Blockage	2/2/2026	9:18:00 AM	2/2/2026	9:19:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66339	WQ0010495090	312 ESTELLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/2/2026	9:25:00 AM	2/2/2026	9:26:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66345	WQ0010495116	3206 GREENPARK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	389	Private Cleanout	Grease Blockage	2/2/2026	10:50:00 AM	2/3/2026	12:46:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66346	WQ0010495090	3009 NAVIGATION BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/2/2026	11:43:00 AM	2/2/2026	11:44:00 AM	0	Cleaned and Disinfected; Cleared Main Line
66349	WQ0010495003	3103 JORNS ST	Storm Sewer (not contained)	Yes	1592	Manhole	Grease Blockage	2/2/2026	1:02:00 PM	2/3/2026	3:34:00 PM	1	Cleared Main Line; Cleaned and Disinfected
66354	WQ0010495076	1317 DE SOTO ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Collection system structural failure	2/3/2026	4:10:00 AM	2/3/2026	4:10:00 AM	0	Cleaned and Disinfected
66356	WQ0010495090	2308 CANAL ST	Storm Sewer (not contained)	Yes	585	Manhole	Grease Blockage	2/2/2026	3:00:00 PM	2/2/2026	6:15:00 PM	3	Cleaned and Disinfected; Cleared Main Line
66357	WQ0010495003	2220 DEVONSHIRE ST	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	2/2/2026	3:55:00 PM	2/2/2026	3:56:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66358	WQ0010495090	530 LINDALE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/2/2026	4:08:00 PM	2/2/2026	4:09:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66359	WQ0010495090	1207 PRAIRIE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/2/2026	5:43:00 PM	2/2/2026	5:44:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66360	WQ0010495090	4424 SHARON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/2/2026	5:29:00 PM	2/2/2026	5:30:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66362	WQ0010495002	6402 TIERWESTER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/3/2026	8:46:00 AM	2/3/2026	8:47:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66365	WQ0010495090	7235 CORPUS CHRISTI ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/4/2026	12:22:00 PM	2/4/2026	12:23:00 PM	0	Cleaned and Disinfected
66367	WQ0010495037	6220 WESTPARK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Sample Well	Grease Blockage	2/3/2026	10:11:00 AM	2/3/2026	10:12:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66374	WQ0010495075	10702 SAGEDOWNE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/3/2026	3:25:00 PM	2/3/2026	3:26:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66376	WQ0010495090	1710 EUEL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/3/2026	4:17:00 PM	2/3/2026	4:18:00 PM	0	Cleaned and Disinfected
66377	WQ0010495090	509 DIPPING LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/4/2026	10:51:00 AM	2/4/2026	10:52:00 AM	0	Cleaned and Disinfected; Cleared Service Lateral
66379	WQ0010495016	7134 TOUCHSTONE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	2/4/2026	9:15:00 AM	2/4/2026	9:16:00 AM	0	Cleaned and Disinfected
66380	WQ0010495090	2044 THONG RD	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	City Cleanout	Rags/Wipes	2/4/2026	9:24:00 AM	2/4/2026	9:25:00 AM	0	Cleaned and Disinfected; Cleared City Clean Out
66382	WQ0010495090	1001 6TH 1/2 ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/4/2026	9:32:00 AM	2/4/2026	9:33:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66384	WQ0010495033	7922 PARDEE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	2/4/2026	9:54:00 AM	2/4/2026	9:55:00 AM	0	Cleaned and Disinfected
66390	WQ0010495090	1205 DART ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	2/4/2026	1:40:00 PM	2/4/2026	1:41:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66392	WQ0010495002	6702 LOOP FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/4/2026	2:40:00 PM	2/4/2026	2:41:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66393	WQ0010495090	1204 VICTOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/4/2026	2:56:00 PM	2/4/2026	2:57:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66394	WQ0010495146	3410 NORTH PARK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2636	Private Cleanout	Grease Blockage	2/4/2026	2:12:00 PM	2/5/2026	12:10:00 PM	2	Cleared Main Line; Cleaned and Disinfected
66400	WQ0010495090	1309 MALVERN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Grease Blockage	2/5/2026	9:04:00 AM	2/5/2026	9:05:00 AM	0	Cleaned and Disinfected
66408	WQ0010495090	1918 LAVERNE ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Collection system structural blockage	2/5/2026	12:54:00 PM	2/5/2026	12:55:00 PM	0	Cleared Main Line; Cleaned and Disinfected; Set Bypass Pump
66409	WQ0010495090	525 PORTWALL ST	Storm Sewer (not contained)	Yes	7400	Manhole	Collection system structural failure	2/5/2026	1:13:00 PM	2/6/2026	1:53:00 PM	5	Cleared Main Line; Cleaned and Disinfected
66410	WQ0010495002	8300 CANYON ST	Storm Sewer (not contained)	Yes	802	Manhole	Grease Blockage	2/5/2026	2:03:00 PM	2/5/2026	7:04:00 PM	3	Cleaned and Disinfected; Cleared Main Line
66412	WQ0010495090	3817 BOLIVIA BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/5/2026	2:59:00 PM	2/5/2026	3:00:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66414	WQ0010495090	1805 DAVIS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/5/2026	4:14:00 PM	2/5/2026	4:15:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66417	WQ0010495090	104 DRESDEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/5/2026	5:03:00 PM	2/5/2026	5:04:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66421	WQ0010495016	10518 WOODWICK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/6/2026	11:01:00 AM	2/6/2026	11:02:00 AM	0	Cleaned and Disinfected; Cleared Main Line
66425	WQ0010495009	4141 BARBERRY DR	Bayou/surface water/drainage ditch	Yes	1273	Manhole	Grease Blockage	2/6/2026	12:40:00 PM	2/6/2026	5:37:00 PM	4	Cleaned and Disinfected; Cleared Main Line
66427	WQ0010495002	8621 JOHN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/6/2026	1:34:00 PM	2/6/2026	1:35:00 PM	0	Cleaned and Disinfected
66428	WQ0010495037	8205 FONDREN RD	Storm Sewer (not contained)	Yes	282	Manhole	Grease Blockage	2/6/2026	12:58:00 PM	2/6/2026	1:19:00 PM	2	Cleared Main Line; Cleaned and Disinfected
66429	WQ0010495009	4114 MAGGIE ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	5756	City Cleanout	Grease Blockage	2/6/2026	2:16:00 PM	2/7/2026	12:10:00 PM	4	Cleared City Clean Out; Cleaned and Disinfected
66430	WQ0010495003	3354 AIRPORT BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/6/2026	3:01:00 PM	2/6/2026	3:02:00 PM	0	Cleared Service Lateral; Cleaned and Disinfected
66432	WQ0010495002	5906 HARBROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/6/2026	3:55:00 PM	2/6/2026	3:56:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66434	WQ0010495076	8041 ELLINGER LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	2/7/2026	9:29:00 AM	2/7/2026	9:30:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66436	WQ0010495002	4122 JULIET ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	Manhole	Grease Blockage	2/7/2026	8:20:00 AM	2/7/2026	8:21:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66442	WQ0010495076	7447 TALL PINES DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/8/2026	9:34:00 AM	2/8/2026	9:35:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66444	WQ0010495002	5921 BERNICE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/8/2026	10:50:00 AM	2/8/2026	10:51:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66451	WQ0010495090	2103 DAVIS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/9/2026	8:55:00 AM	2/9/2026	8:56:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66453	WQ0010495090	6923 AVENUE Q	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/9/2026	9:55:00 AM	2/9/2026	9:56:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66454	WQ0010495090	9480 LONG POINT RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	2/9/2026	10:31:00 AM	2/9/2026	10:32:00 AM	0	Set Bypass Pump; Cleaned and Disinfected
66456	WQ0010495152	307 FLORA VISTA DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/9/2026	10:21:00 AM	2/9/2026	10:22:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66457	WQ0010495003	1332 J AMBROSE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	495	Manhole	Collection system structural blockage	2/9/2026	10:43:00 AM	2/9/2026	1:28:00 PM	3	Cleared Main Line; Cleaned and Disinfected
66458	WQ0010495075	12018 WESSEX DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/9/2026	11:07:00 AM	2/9/2026	11:08:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66459	WQ0010495002	6150 BELCREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/9/2026	11:08:00 AM	2/9/2026	11:09:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66460	WQ0010495037	6550 HILLCROFT AVE	Storm Sewer (not contained)	Yes	278	Manhole	Grease Blockage	2/9/2026	12:34:00 PM	2/9/2026	2:53:00 PM	2	Cleared Main Line; Cleaned and Disinfected
66461	WQ0010495090	709 BARKLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	2/9/2026	12:41:00 PM	2/9/2026	12:42:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66462	WQ0010495016	9700 MESA DR	Storm Sewer (not contained)	Yes	1365	Manhole	Grease Blockage	2/9/2026	12:45:00 PM	2/10/2026	11:30:00 AM	1	Cleared Main Line; Cleaned and Disinfected
66463	WQ0010495090	1609 GENTRY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/9/2026	1:39:00 PM	2/9/2026	1:40:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works  
 Monthly SSO Report  
 February 2026

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
66465	WQ0010495003	2421 TANGLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system temporary blockage	2/9/2026	2:20:00 PM	2/9/2026	2:21:00 PM	0	Cleaned and Disinfected
66467	WQ0010495037	9203 SANFORD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/9/2026	2:26:00 PM	2/9/2026	2:27:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66468	WQ0010495002	8241 BONNER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/9/2026	2:26:00 PM	2/9/2026	2:27:00 PM	0	Cleaned and Disinfected
66470	WQ0010495090	5910 MARKET ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	141	Private Sample Well	Roots	2/9/2026	3:08:00 PM	2/9/2026	5:29:00 PM	1	Cleaned and Disinfected
66478	WQ0010495002	5601 ROYAL PALMS ST	Storm Sewer (not contained)	Yes	1420	City Cleanout	Grease Blockage	2/10/2026	8:43:00 AM	2/10/2026	1:27:00 PM	5	Cleared Main Line; Cleaned and Disinfected
66481	WQ0010495009	4414 PHLOX ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/10/2026	10:01:00 AM	2/10/2026	10:02:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66482	WQ0010495023	6713 MARIOSA ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	Service Lateral	Collection system structural failure	2/10/2026	10:37:00 AM	2/10/2026	10:38:00 AM	0	Cleaned and Disinfected; Set Bypass Pump
66490	WQ0010495090	1001 6TH 1/2 ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/10/2026	1:29:00 PM	2/10/2026	1:30:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66491	WQ0010495090	5812 HIRSCH RD	Storm Sewer (not contained)	Yes	133	Manhole	Grease Blockage	2/10/2026	1:21:00 PM	2/10/2026	3:34:00 PM	1	Cleared Main Line; Cleaned and Disinfected
66493	WQ0010495016	9305 WAYSIDE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/10/2026	2:26:00 PM	2/10/2026	2:27:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66494	WQ0010495090	7313 DOMINO LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/10/2026	2:23:00 PM	2/10/2026	2:24:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66496	WQ0010495090	4609 MARKET ST	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Grease Blockage	2/10/2026	2:31:00 PM	2/10/2026	2:32:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66497	WQ0010495002	6507 SOUTHBROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/10/2026	3:40:00 PM	2/10/2026	3:41:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66498	WQ0010495090	221 CAYLOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2140	Private Cleanout	Grease Blockage	2/10/2026	3:50:00 PM	2/11/2026	9:40:00 AM	2	Cleaned and Disinfected; Cleared Main Line
66500	WQ0010495110	15918 HIRAM CLARKE RD	Storm Sewer (not contained)	Yes	1109	Manhole	Grease Blockage	2/10/2026	4:01:00 PM	2/11/2026	10:30:00 AM	1	Cleared Main Line; Cleaned and Disinfected
66503	WQ0010495077	12813 COULSON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/10/2026	4:48:00 PM	2/10/2026	4:49:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66505	WQ0010495002	7202 PATRICIA LN	Storm Sewer (not contained)	Yes	504	Manhole	Grease Blockage	2/11/2026	9:03:00 AM	2/11/2026	11:47:00 AM	3	Cleaned and Disinfected; Cleared Main Line
66506	WQ0010495112	22627 SHOREWOOD LOOP	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/12/2026	12:33:00 PM	2/12/2026	12:34:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66510	WQ0010495009	3525 FIJQUA ST	Bayou/surface water/drainage ditch	Yes	203	Manhole	Grease Blockage	2/11/2026	10:33:00 AM	2/11/2026	1:56:00 PM	1	Cleared Main Line; Cleaned and Disinfected
66512	WQ0010495099	8623 KINDLETREE DR	Storm Sewer (not contained)	Yes	76	Manhole	Grease Blockage	2/11/2026	11:29:00 AM	2/11/2026	12:07:00 PM	2	Cleared Main Line; Cleaned and Disinfected
66516	WQ0010495002	7373 ARDMORE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2938	Manhole	Collection system structural failure	2/11/2026	11:21:00 AM	2/12/2026	11:50:00 AM	2	Set Bypass Pump; Cleaned and Disinfected
66518	WQ0010495002	4314 CLAY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	2/11/2026	11:57:00 AM	2/11/2026	11:58:00 AM	0	Cleaned and Disinfected; Cleared Main Line
66519	WQ0010495009	4609 MALLOW ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/11/2026	11:50:00 AM	2/11/2026	11:51:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66524	WQ0010495095	12311 SHANNON HILLS DR	Storm Sewer (not contained)	Yes	312	Manhole	Grease Blockage	2/11/2026	3:48:00 PM	2/11/2026	9:00:00 PM	1	Cleared Main Line; Cleaned and Disinfected
66527	WQ0010495077	668 MAXEY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	51	City Cleanout	Rags/Wipes	2/11/2026	4:46:00 PM	2/12/2026	12:32:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66533	WQ0010495030	1103 BLUE WILLOW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/12/2026	10:01:00 AM	2/12/2026	10:02:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66534	WQ0010495016	7634 TEESDALE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	2/12/2026	9:41:00 AM	2/12/2026	9:42:00 AM	0	Cleaned and Disinfected
66536	WQ0010495090	5610 CROSSTIMBERS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/12/2026	11:45:00 AM	2/12/2026	11:46:00 AM	0	Cleaned and Disinfected; Cleared City Clean Out
66540	WQ0010495037	6000 REIMS RD	Storm Sewer (not contained)	Yes	520	Manhole	Grease Blockage	2/12/2026	12:21:00 PM	2/12/2026	2:17:00 PM	5	Cleared Main Line; Cleaned and Disinfected
66548	WQ0010495090	1415 BRINGHURST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/12/2026	3:06:00 PM	2/12/2026	3:07:00 PM	0	Set Bypass Pump; Cleaned and Disinfected
66556	WQ0010495076	8033 DYER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	2/13/2026	12:37:00 PM	2/13/2026	12:38:00 PM	0	Cleaned and Disinfected
66558	WQ0010495090	4321 HAYGOOD ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Collection system structural failure	2/13/2026	12:50:00 PM	2/13/2026	12:51:00 PM	0	Cleared Service Lateral
66559	WQ0010495002	1500 LAWNDALE PLZ	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2596	Manhole	Grease Blockage	2/13/2026	1:21:00 PM	2/14/2026	10:59:00 AM	2	Cleared Main Line; Cleaned and Disinfected
66561	WQ0010495090	1024 23RD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/13/2026	2:27:00 PM	2/13/2026	2:28:00 PM	0	Cleaned and Disinfected; Set Bypass Pump
66562	WQ0010495090	4600 SHERWOOD LN	Bayou/surface water/drainage ditch	Yes	0	Gravity Main	Grease Blockage	2/13/2026	2:40:00 PM	2/13/2026	2:41:00 PM	0	Cleared Main Line
66564	WQ0010495002	8535 WINKLER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	2/13/2026	4:08:00 PM	2/13/2026	4:09:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66565	WQ0010495110	4902 CROKER RIDGE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/13/2026	4:47:00 PM	2/13/2026	4:48:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66566	WQ0010495002	3730 LEHALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/14/2026	8:42:00 AM	2/14/2026	8:43:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66568	WQ0010495009	5103 HIGGINS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Grease Blockage	2/14/2026	1:09:00 PM	2/14/2026	1:10:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66572	WQ0010495037	5759 WILLOWBEND BLVD	Storm Sewer (not contained)	Yes	94	Manhole	Rags/Wipes	2/15/2026	12:05:00 PM	2/15/2026	3:12:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66575	WQ0010495030	12603 KINGSDALE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/16/2026	8:51:00 AM	2/16/2026	8:52:00 AM	0	Cleaned and Disinfected; Set Bypass Pump
66576	WQ0010495119	11350 BARRETT BRAE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/16/2026	9:19:00 AM	2/16/2026	9:20:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66577	WQ0010495090	4418 JEFFERSON ST	Storm Sewer (not contained)	Yes	126	Manhole	Grease Blockage	2/16/2026	9:40:00 AM	2/16/2026	11:56:00 AM	1	Cleared Main Line; Cleaned and Disinfected
66578	WQ0010495030	1702 TRIWAY LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/16/2026	10:11:00 AM	2/16/2026	10:12:00 AM	0	Cleaned and Disinfected; Set Bypass Pump
66579	WQ0010495003	12014 ZAVALLA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Grease Blockage	2/16/2026	10:20:00 AM	2/16/2026	10:21:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66587	WQ0010495090	510 ELEANOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/17/2026	8:44:00 AM	2/17/2026	8:45:00 AM	0	Cleaned and Disinfected
66589	WQ0010495037	8502 CLAREWOOD DR	Storm Sewer (not contained)	Yes	768	Manhole	Grease Blockage	2/17/2026	9:48:00 AM	2/17/2026	2:04:00 PM	3	Cleared Main Line; Cleaned and Disinfected
66591	WQ0010495002	5601 ROYAL PALMS ST	Storm Sewer (not contained)	Yes	795	City Cleanout	Rags/Wipes	2/17/2026	10:11:00 AM	2/17/2026	12:50:00 PM	5	Cleared City Clean Out; Cleaned and Disinfected
66592	WQ0010495002	6199 GRIGGS RD	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	Private Sample Well	Grease Blockage	2/17/2026	10:10:00 AM	2/17/2026	10:11:00 AM	0	Cleaned and Disinfected; Cleared City Clean Out
66593	WQ0010495090	9206 SHOREHAM ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	2/17/2026	10:53:00 AM	2/17/2026	10:54:00 AM	0	Cleaned and Disinfected
66594	WQ0010495050	1313 LASKEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/17/2026	9:40:00 AM	2/17/2026	9:41:00 AM	0	Cleaned and Disinfected; Cleared Main Line
66596	WQ0010495111	11360 BELLAIRE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Sample Well	Collection system structural failure	2/17/2026	10:58:00 AM	2/17/2026	10:59:00 AM	0	Cleared Main Line
66601	WQ0010495002	3043 GOLFCREST BLVD	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	268	Service Lateral	Collection system structural failure	2/17/2026	11:16:00 AM	2/17/2026	3:44:00 PM	1	Cleaned and Disinfected
66607	WQ0010495002	5926 SOUTHLARK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/17/2026	12:35:00 PM	2/17/2026	12:36:00 PM	0	Set Bypass Pump; Cleaned and Disinfected
66608	WQ0010495077	13370 KNOLLCREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	2/17/2026	12:14:00 PM	2/17/2026	12:15:00 PM	0	Cleaned and Disinfected
66609	WQ0010495002	3826 LEHALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	2/17/2026	12:50:00 PM	2/17/2026	12:51:00 PM	0	Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works  
 Monthly SSO Report  
 February 2026

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
66611	WQ0010495002	5911 BOIS D ARC ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/17/2026	1:10:00 PM	2/17/2026	1:11:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66612	WQ0010495002	6401 SIDNEY ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	2/17/2026	2:23:00 PM	2/17/2026	2:24:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66615	WQ0010495003	7340 WASHINGTON AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/17/2026	2:17:00 PM	2/17/2026	2:18:00 PM	0	Set Bypass Pump; Cleaned and Disinfected
66619	WQ0010495090	514 WEST CROSS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	134	Manhole	Rags/Wipes	2/17/2026	3:01:00 PM	2/17/2026	3:15:00 PM	1	Cleared Main Line; Cleaned and Disinfected
66624	WQ0010495090	3011 FOLGER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	410	Manhole	Grease Blockage	2/17/2026	4:12:00 PM	2/17/2026	6:10:00 PM	3	Cleared Main Line; Cleaned and Disinfected
66626	WQ0010495090	402 BOUNDARY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/17/2026	5:14:00 PM	2/17/2026	5:15:00 PM	0	Cleaned and Disinfected
66628	WQ0010495037	7419 ASHCROFT DR	Storm Sewer (not contained)	Yes	440	Private Cleanout	Rags/Wipes	2/18/2026	8:20:00 AM	2/18/2026	12:00:00 PM	2	Cleared City Clean Out; Cleaned and Disinfected
66640	WQ0010495090	1516 ROSEWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system temporary blockage	2/18/2026	11:48:00 AM	2/18/2026	11:49:00 AM	0	Cleaned and Disinfected
66646	WQ0010495002	7104 LA PASEO ST	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	2/18/2026	3:45:00 PM	2/18/2026	3:46:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66647	WQ0010495119	8999 2/3 RICHMOND	Storm Sewer (not contained)	Yes	308	Manhole	Grease Blockage	2/18/2026	4:26:00 PM	2/18/2026	7:00:00 PM	2	Cleared Main Line; Cleaned and Disinfected
66651	WQ0010495002	8902 WYNMEADOW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/19/2026	8:10:00 AM	2/19/2026	9:11:00 AM	0	Cleaned and Disinfected; Set Bypass Pump
66652	WQ0010495090	5604 HARVARD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/19/2026	11:17:00 AM	2/19/2026	11:18:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66662	WQ0010495090	5201 COLLINGSWORTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	2/19/2026	1:31:00 PM	2/19/2026	1:32:00 PM	0	Cleared Service Lateral
66665	WQ0010495002	6710 WHITEFIARS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/19/2026	2:22:00 PM	2/19/2026	2:23:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66666	WQ0010495016	9009 SURRY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/19/2026	3:00:00 PM	2/19/2026	3:01:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66675	WQ0010495119	12109 TAMBOURINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/20/2026	9:08:00 AM	2/20/2026	9:09:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66676	WQ0010495077	12649 MCNAIR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/20/2026	9:50:00 AM	2/20/2026	9:51:00 AM	0	Cleaned and Disinfected
66680	WQ0010495002	808 LENOX ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/20/2026	11:00:00 AM	2/20/2026	11:01:00 AM	0	Cleaned and Disinfected
66683	WQ0010495002	4307 ROSENEATH DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/20/2026	1:20:00 PM	2/20/2026	1:21:00 PM	0	Cleaned and Disinfected
66686	WQ0010495002	4514 DIXIE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/20/2026	3:30:00 PM	2/20/2026	3:31:00 PM	0	Cleared City Clean Out; Cleaned and Disinfected
66690	WQ0010495119	11607 DUNFIELD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/20/2026	5:16:00 PM	2/20/2026	5:17:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66691	WQ0010495119	11426 MONTVERDE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2700	Manhole	Grease Blockage	2/20/2026	5:16:00 PM	2/21/2026	11:16:00 AM	2	Cleaned and Disinfected; Cleared Main Line
66693	WQ0010495090	702 MAJORCA DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/21/2026	9:07:00 AM	2/21/2026	9:08:00 AM	0	Cleaned and Disinfected
66697	WQ0010495090	5301 TEXAS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/21/2026	12:30:00 PM	2/21/2026	12:31:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66706	WQ0010495112	24203 SUNNY GLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system temporary blockage	2/22/2026	12:15:00 PM	2/22/2026	12:16:00 PM	0	Cleaned and Disinfected; Cleared Main Line
66709	WQ0010495002	4105 LAMAR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/23/2026	9:20:00 AM	2/23/2026	9:21:00 AM	0	Cleaned and Disinfected; Cleared City Clean Out
66711	WQ0010495090	1010 ANTOINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1680	Manhole	Grease Blockage	2/23/2026	10:54:00 AM	2/23/2026	4:30:00 PM	5	Cleaned and Disinfected; Cleared Main Line
66716	WQ0010495077	1633 MILES ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/23/2026	12:38:00 PM	2/23/2026	12:39:00 PM	0	Cleaned and Disinfected
66727	WQ0010495090	6716 SHERMAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	2/24/2026	10:50:00 AM	2/24/2026	10:51:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66729	WQ0010495090	4400 18TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1320	Manhole	Grease Blockage	2/24/2026	1:07:00 PM	2/24/2026	5:31:00 PM	5	Cleared Main Line; Cleaned and Disinfected
66731	WQ0010495090	105 2/3 SABINE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/24/2026	3:09:00 PM	2/24/2026	3:10:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66733	WQ0010495075	11131 SAGEPARK LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/24/2026	3:10:00 PM	2/24/2026	3:11:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66734	WQ0010495002	3509 ENNIS ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	2/24/2026	4:50:00 PM	2/24/2026	4:51:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66742	WQ0010495009	4600 REED RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	2/25/2026	10:45:00 AM	2/25/2026	10:46:00 AM	0	Cleaned and Disinfected
66743	WQ0010495076	8650 RANNIE RD	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Collection system structural failure	2/25/2026	11:22:00 AM	2/25/2026	11:23:00 AM	0	Cleaned and Disinfected
66749	WQ0010495002	9340 LAWNDALE ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	1149	Manhole	Collection system structural failure	2/25/2026	3:07:00 PM	2/25/2026	9:30:00 PM	3	Cleaned and Disinfected; Contain All or Portion of Spill; Cleared Main Line; Set Bypass Pump
66750	WQ0010495037	9605 STELLA LINK RD	Storm Sewer (not contained)	Yes	0	City Cleanout	Grease Blockage	2/25/2026	3:05:00 PM	2/25/2026	3:06:00 PM	0	Cleared Main Line; Cleaned and Disinfected
66751	WQ0010495002	1162 ALLEN GENOA RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/25/2026	4:48:00 PM	2/25/2026	4:49:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66755	WQ0010495002	6434 SHERWOOD DR	Storm Sewer (not contained)	Yes	6670	Manhole	Collection system temporary blockage	2/26/2026	10:40:00 AM	2/27/2026	10:30:00 AM	5	Cleaned and Disinfected; Cleared Main Line
66758	WQ0010495003	2012 WHITNEY ST	Storm Sewer (not contained)	Yes	0	Manhole	Rags/Wipes	2/26/2026	11:16:00 AM	2/26/2026	11:17:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66760	WQ0010495002	3217 IDLA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	2/26/2026	12:49:00 PM	2/26/2026	12:50:00 PM	0	Cleaned and Disinfected; Cleared City Clean Out
66763	WQ0010495090	7411 WHEATLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/26/2026	2:04:00 PM	2/26/2026	2:05:00 PM	0	Set Bypass Pump
66768	WQ0010495090	2316 CHURCHILL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	2/26/2026	5:00:00 PM	2/26/2026	5:01:00 PM	0	Cleaned and Disinfected
66769	WQ0010495003	10514 BUFFUM ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	2/27/2026	8:15:00 AM	2/27/2026	8:16:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66770	WQ0010495090	3912 LOCKWOOD DR	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	2/27/2026	8:49:00 AM	2/27/2026	9:50:00 AM	0	Cleared City Clean Out; Cleaned and Disinfected
66772	WQ0010495009	11702 MILL VALLEY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	190	Private Cleanout	Collection system structural failure	2/27/2026	9:25:00 AM	2/27/2026	11:00:00 AM	2	Cleared Main Line; Cleaned and Disinfected; Set Bypass Pump
66774	WQ0010495090	1207 33RD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/27/2026	11:25:00 AM	2/27/2026	11:26:00 AM	0	Cleaned and Disinfected; Cleared City Clean Out


Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works  
 Monthly SSO Report  
 February 2026

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
66775	WQ0010495016	7939 DEWITT RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	2/27/2026	10:57:00 AM	2/27/2026	10:58:00 AM	0	Cleared Main Line; Cleaned and Disinfected
66776	WQ0010495009	11403 MARTIN LUTHER KING BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/27/2026	10:47:00 AM	2/27/2026	10:48:00 AM	0	Cleaned and Disinfected; Set Bypass Pump
66777	WQ0010495009	5247 FAIRGREEN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	2/27/2026	12:26:00 PM	2/27/2026	12:27:00 PM	0	Cleared Service Lateral; Cleaned and Disinfected
66778	WQ0010495002	4742 WINNETKA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	2/27/2026	12:15:00 PM	2/27/2026	12:16:00 PM	0	Set Bypass Pump; Cleaned and Disinfected
66780	WQ0010495003	2909 AIRPORT BLVD	Storm Sewer (not contained)	Yes	10344	Manhole	Grease Blockage	2/27/2026	12:54:00 PM	3/1/2026	8:00:00 AM	4	Cleared Main Line; Cleaned and Disinfected
66781	WQ0010495090	8403 LANEWOOD DR	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Collection system structural failure	2/27/2026	12:51:00 PM	2/27/2026	12:52:00 PM	0	Cleaned and Disinfected; Cleared Service Lateral
66787	WQ0010495146	4215 SABLE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2262	Manhole	Grease Blockage	2/27/2026	4:52:00 PM	2/28/2026	11:43:00 AM	2	Cleared Main Line; Cleaned and Disinfected
66788	WQ0010495037	7516 HILLCROFT AVE	Storm Sewer (not contained)	Yes	2548	City Cleanout	Collection system structural failure	2/27/2026	5:36:00 PM	3/1/2026	12:04:00 PM	1	Cleaned and Disinfected
66792	WQ0010495116	7505 WESTHEIMER RD	Storm Sewer (not contained)	Yes	4408	Gravily Main	Grease Blockage	2/28/2026	10:28:00 AM	3/3/2026	11:56:00 AM	1	Cleared Main Line; Cleaned and Disinfected

Total Number of SSOs:	168
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

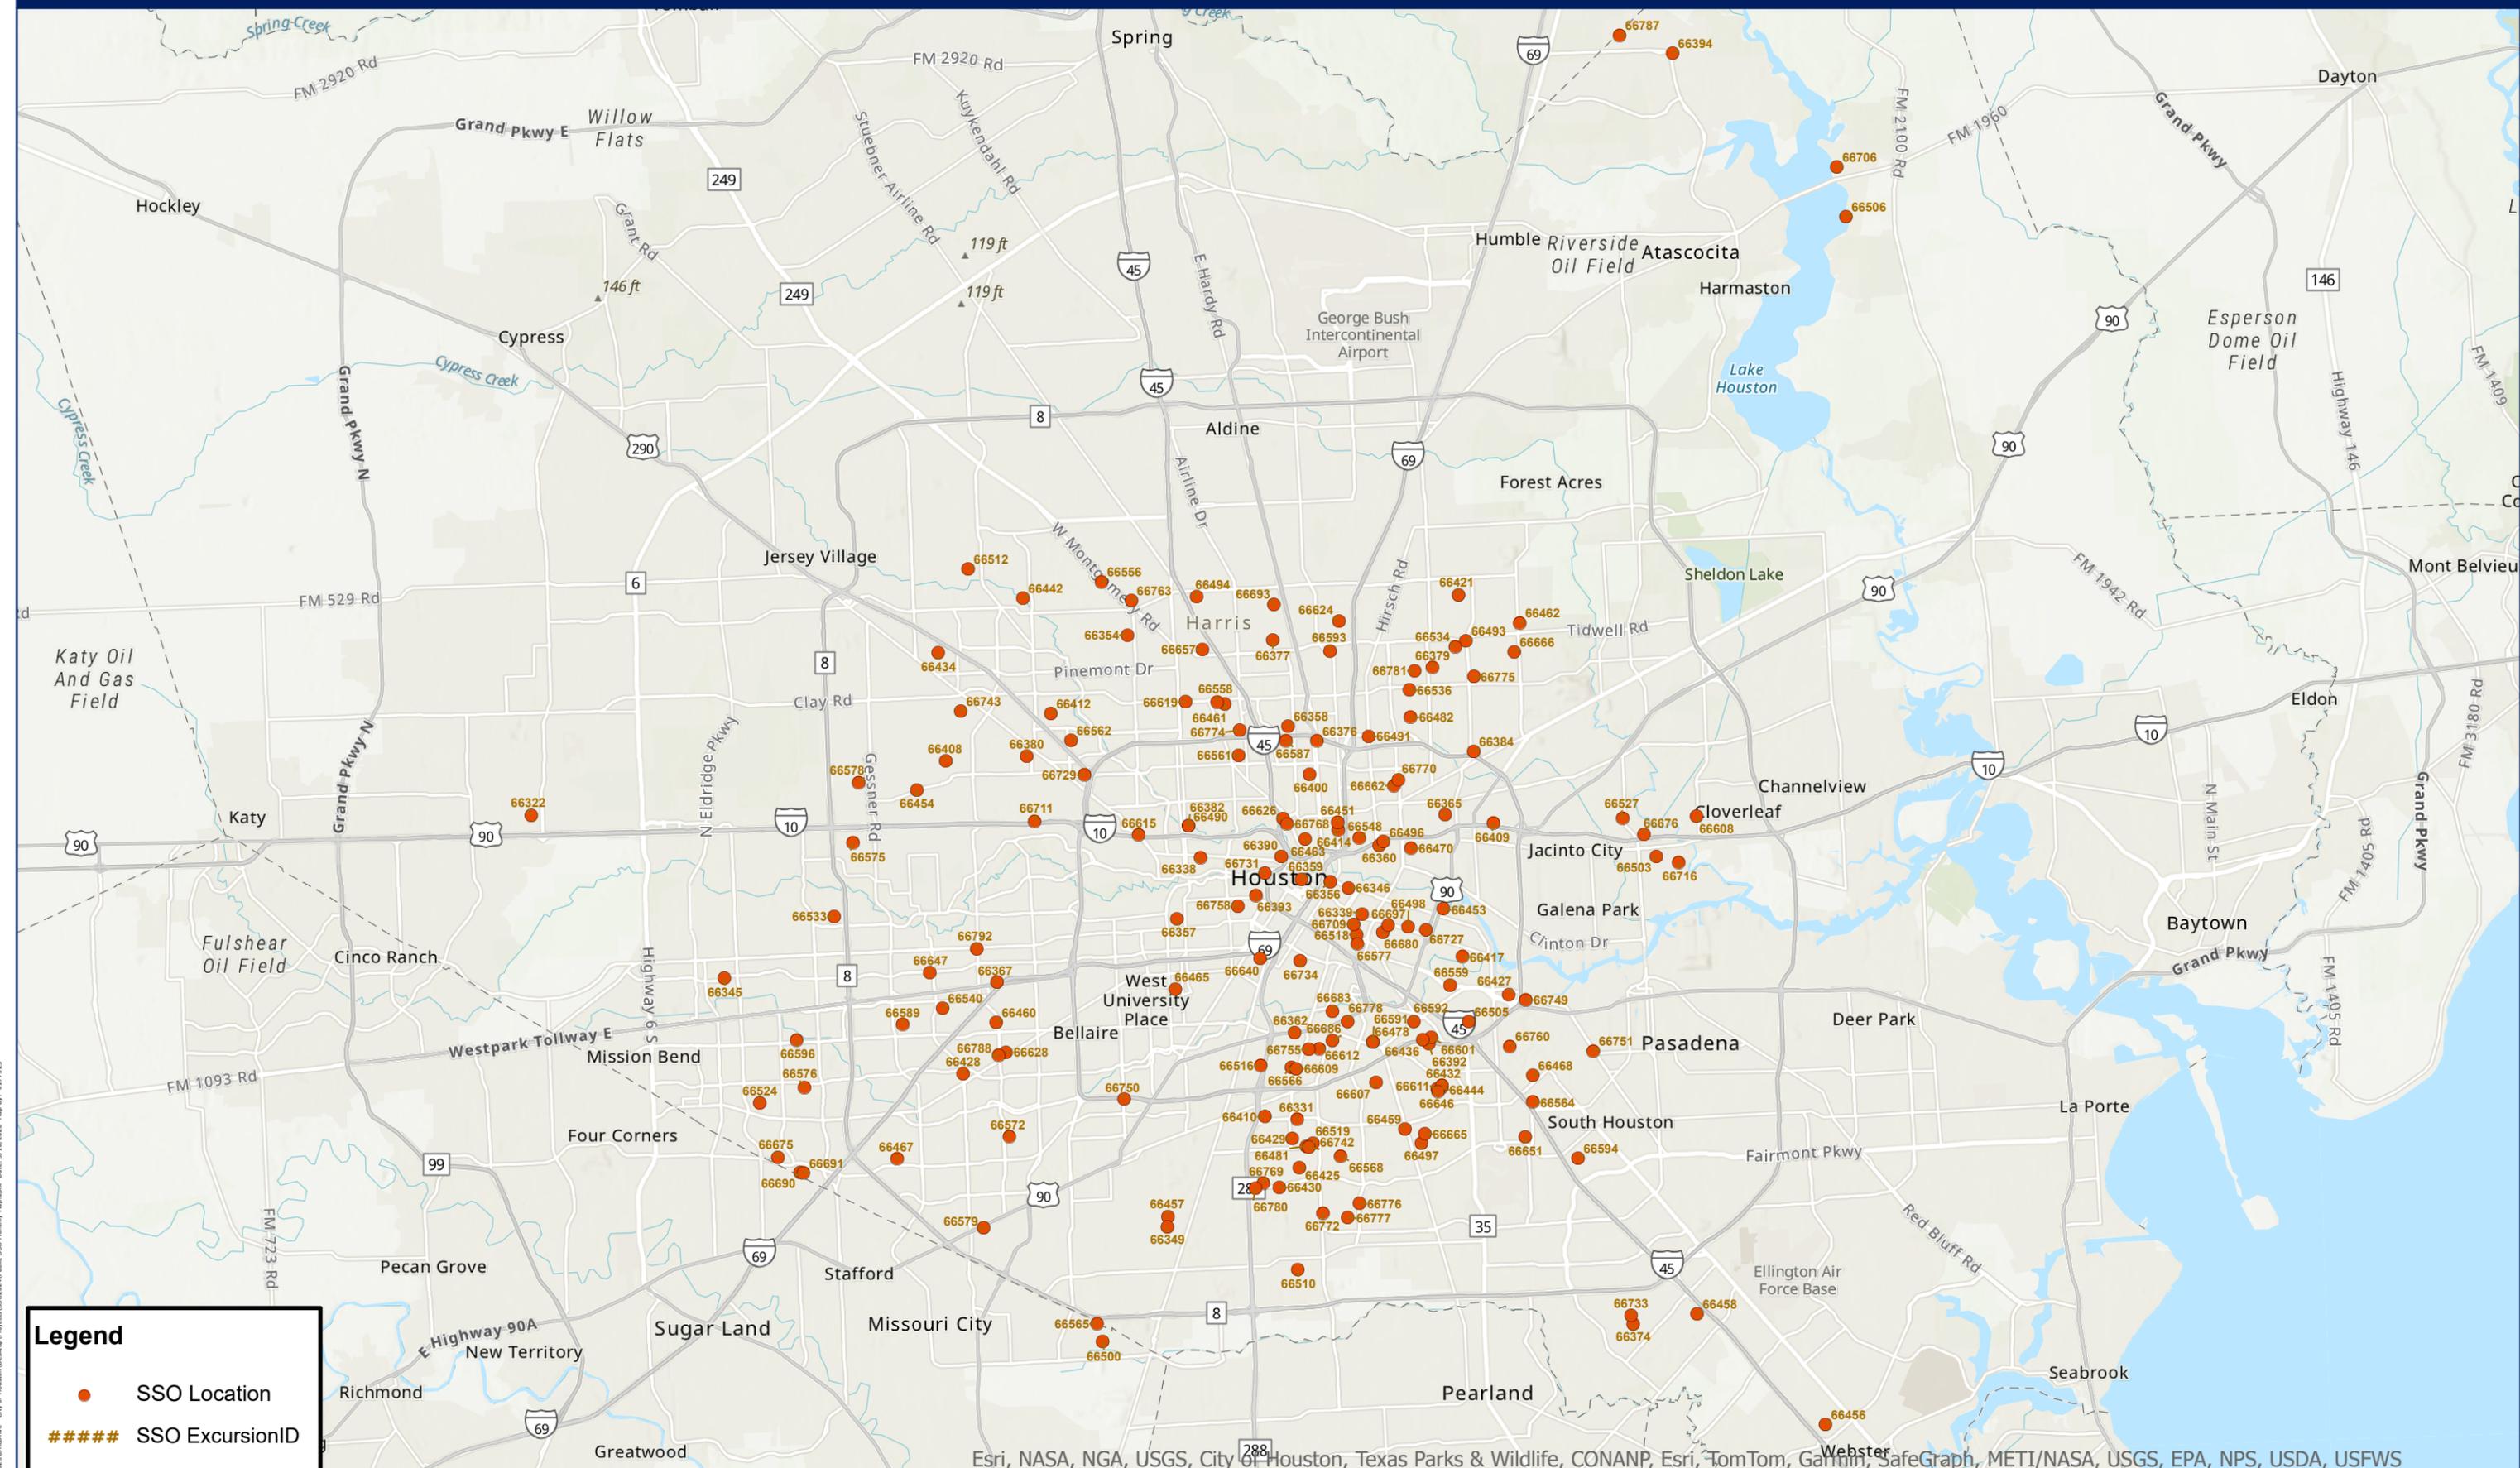

Document Path: C:\Users\j1752\OneDrive - City of Houston\Desktop\Projects\SSO\SSO Public SSO Monthly Map.aprx Date: 3/10/2026 Map By: e17753

**Legend**

- SSO Location
- ##### SSO ExcursionID

Esri, NASA, NGA, USGS, City of Houston, Texas Parks & Wildlife, CONANP, Esri, TomTom, Garmin, SafeGraph, METI/NASA, USGS, EPA, NPS, USDA, USFWS



Geospatial or map data maintained by Houston Public Works is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and only represents the approximate location of property boundaries.

# Public SSO Map - February 2026

